



POWER TRANSMISSION AND DISTRIBUTION DL GTU102-S



Introduction:

Today, the public electric power is supplied almost exclusively using three-phase systems with frequency of 50 or 60 Hz, depending on the country. The major advantage of AC three-phase over DC power systems is that the electrical power is generated economically in large power stations relatively far from the end users, transported at high voltage over long distances with very little power loss and finally made available to the consumers providing them with two different levels of voltage depending on the application needs.

The major components of electric power transmission and distribution systems are:

- Transformers: step up transformers increase the generated voltage to values suitable for high voltage transmission systems, isolation transformers are used to exchange power between networks, and step down transformers decrease the voltages to medium voltage level and further down to low voltage to be distributed to the consumer.
- Transmission lines: overhead power lines are mainly used to transmit electrical energy from the power stations
 to the consumers. However, in densely populated areas the power can only be supplied via cables. Various
 voltage levels are used for transmitting power; the levels are determined by the amount of power and the
 distance; the higher the transmission voltages, the lower the currents as well as the transmission losses.
 However, it must also be considered that network investment costs increase with the voltage.
- Busbars, disconnectors and power circuit breakers: they are the main components found in a switching station used for power distribution.

To evaluate the optimum network configuration complex calculations have to be carried out.






Laboratory description

In this laboratory the basic circuits of power engineering, series and parallel connections of operating equipment (lines, transformers) as well as circuits involving the conversion of delta connections to star connections and vice versa, are analysed. Our system, composed of a modular configuration, allows the student to identify immediately the main components. Three-phase transformers, transmission lines and bus bar are the main subjects of study. The entire lab can be divided in three different configurations, related to the three subjects of study, in order to perform a didactic experience focussed on that specific field.

The graph below consists in a block diagram, which clarifies the system division, subjects of study and expansions.

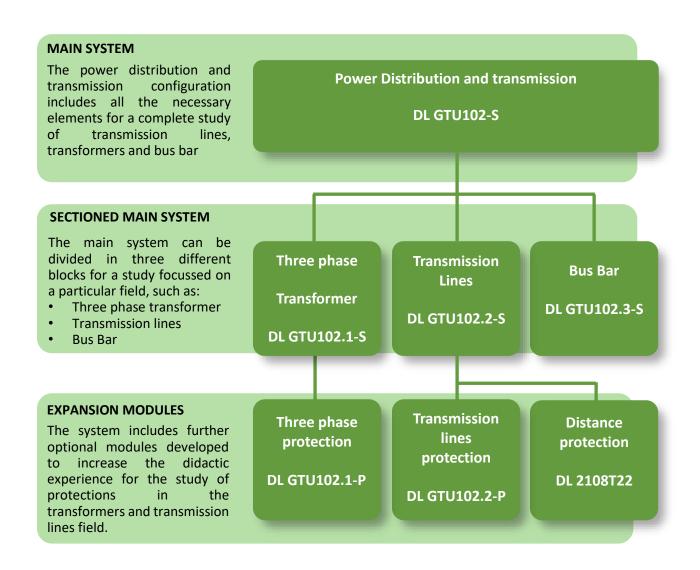





Experiments:

DL GTU102-S - Power Distribution and transmission

DL GTU102.1-S - Three-phase transformers

- Transformer vector group.
- Transformer no load performance.
- Transformer short-circuit performance and equivalent circuit.
- Load performance.
- Zero impedance.
- Asymmetrical load.
- Autotransformer.
- Parallel operation.

DL GTU102.2-S - Transmission lines

Studies on three-phase transmission lines

- No-load performance, Ferranti effect.
- Matched load performance.
- Three-phase symmetrical short-circuits.
- Resistive-inductive load.
- Resistive-capacitive load.
- Zero-phase impedance.
- Parallel compensation for a resistive-inductive load.
- Series compensation for a resistive-inductive load.
- Three-phase asymmetric short-circuit.

Parallel and series connection of transmission lines

- Series connection of two lines.
- Parallel connection of two lines.

Transmission line with earth-fault compensation

- Earth fault on a line with an isolated star point.
- Petersen suppression coil.

DL GTU102.3-S - Power distribution

Three-pole double busbar systems

- Basic double busbar system.
- Double busbar system with load.
- Busbar coupling.

Network topologies

- Radial network.
- Meshed network.





Expansion:

Adding optional modules to the configurations (DL GTU102-S or DL GTU102.1-S and DL GTU102.2-S), the available list of experiments and system capabilities are expanded.

DL GTU102.1-P

Transformer protection

- Paramenter configuration, fault simulation, relay response measurement and oscillograph recording for the following protections:
- •Time overcurrent protection
- •Transformer differential protection

DL GTU102.2-P

Transmission line protection

- Paramenter configuration, fault simulation, relay response measurement and oscillograph recording for the following protections:
- •Inverse time overcurrent protection
- Earth-fault protection
- Undervoltage and overvoltage protection
- Unbalanced load protection
- Directional power protection
- Protection of parallel connected lines

DL 2108T22

Distance protection

- Paramenter configuration, fault simulation, relay response measurement and recording for the following protections:
- Overcurrent protection
- Overvoltage protection
- Undervoltage protection
- Unbalanced load protection
- Distance protection





List of modules

DL GTU102-S

| DL 1013T1MR | Motorized variable three-phase power supply | 1 |
|----------------|---|---|
| DL 1080TT | Three-phase transformer | 2 |
| DL 2109T29 | Three-phase power meter | 2 |
| DL 1017R | Resistive load | 1 |
| DL 1017L | Inductive load | 1 |
| DL 1017C | Capacitive load | 1 |
| DL 2108T02 | Power circuit breaker | 4 |
| DL 2109D51 | Digital Vector group meter | 1 |
| DL 2109D30 | Digital Power meter | 1 |
| DL 7901TT | Overhead line model | 2 |
| DL 7901TTS | Overhead line model 110Km | 1 |
| DL 2108T03 | Line capacitor | 2 |
| DL 2108T04 | Petersen Coil | 1 |
| DL 2108T02/2 | Double busbar with two disconnectors | 3 |
| DL 2102AL | Three-phase supply unit | 1 |
| DL HUBRS485F | Communication MODBUS | 1 |
| DL 2600TTI | Three-phase isolation transformer | 1 |
| DL SCADA-WEB | SCADA Software | 1 |
| DL PCGRID | All-in-One Computer | 1 |
| TLGTU102.T | Cables | 1 |
| DL 1196 | Holder for leads | 1 |
| DL T12090_SK | 120x90 working bench | 2 |
| DL T06090 | 60x90 working bench | 2 |
| DL A120-3M-LED | Three-level work frame with LED light | 2 |

Expansion modules

DL GTU102.1-P

| DL 2108T21 | Differential transformer relay | 1 |
|------------|---------------------------------|---|
| DL 2109T22 | Three-phase current transformer | 2 |
| DL T06090 | 60x90 working bench | 1 |

DL GTU102.2-P

| DL 2108T13 | Inverse time overcurrent relay | 1 |
|------------|--------------------------------|---|
| DL 2108T18 | Earth-fault relay | 1 |
| DL 2108T23 | Feeder manager relay | 1 |

DL 2108T22

| DL 2108T22 | Distance protection relay | 1 |
|------------|---------------------------|---|





DL GTU102.1-S

| DL 1013T1MR | Motorized variable three-phase power supply | 1 |
|----------------|---|---|
| DL 1080TT | Three-phase transformer | 2 |
| DL 2109T29 | Three-phase power meter | 2 |
| DL 1017R | Resistive load | 1 |
| DL 1017L | Inductive load | 1 |
| DL 1017C | Capacitive load | 1 |
| DL 2108T02 | Power circuit breaker | 1 |
| DL 2109D51 | Digital Vector group meter | 1 |
| DL HUBRS485F | Communication MODBUS | 1 |
| DL 2600TTI | Three-phase isolation transformer | 1 |
| DL SCADA-WEB | SCADA Software | 1 |
| DL PCGRID | All-in-One Computer | 1 |
| TLGTU102.X | Cables | 1 |
| DL 1196 | Holder for leads | 1 |
| DL T12090_SK | 120x90 working bench | 1 |
| DL T06090 | 60x90 working bench | 1 |
| DL A120-3M-LED | Three-level work frame with LED light | 1 |

Expansion modules

DL GTU102.1-P

| DL 2108T21 | Differential transformer relay | 1 |
|------------|---------------------------------|---|
| DL 2109T22 | Three-phase current transformer | 2 |
| DL T06090 | 60x90 working bench | 1 |





List of modules

DL GTU102.2-S

| DL 1013T1MR | Motorized variable three-phase power supply | 1 |
|----------------|---|---|
| DL 1080TT | Three-phase transformer | 1 |
| DL 2109T29 | Three-phase power meter | 2 |
| DL 1017R | Resistive load | 1 |
| DL 1017L | Inductive load | 1 |
| DL 1017C | Capacitive load | 1 |
| DL 2108T02 | Power circuit breaker | 2 |
| DL 2108T03 | Line capacitor | 2 |
| DL 2109D30 | Digital Power meter | 1 |
| DL 7901TT | Overhead line model | 2 |
| DL 7901TTS | Overhead line model 110Km | 1 |
| DL 2108T04 | Petersen Coil | 1 |
| DL HUBRS485F | Communication MODBUS | 1 |
| DL 2600TTI | Three-phase isolation transformer | 1 |
| DL SCADA-WEB | SCADA Software | 1 |
| DL PCGRID | All-in-One Computer | 1 |
| TLGTU102.X | Cables | 1 |
| DL 1196 | Holder for leads | 1 |
| DL T12090_SK | 120x90 working bench | 2 |
| DL A120-3M-LED | Three-level work frame with LED light | 2 |

Expansion modules

DL GTU102.2-P

| DL 2108T13 | Inverse time overcurrent relay | 1 |
|------------|--------------------------------|---|
| DL 2108T18 | Earth-fault relay | 1 |
| DL 2108T23 | Feeder manager relay | 1 |

DL 2108T22

| DL 2108T22 | Distance protection relay | 1 |
|------------|---------------------------|---|
| | | |





List of modules

DL GTU102.3-S

| DL 1080TT | Three-phase transformer | 1 |
|----------------|---------------------------------------|---|
| DL 2109T29 | Three-phase power meter | 2 |
| DL 1017R | Resistive load | 1 |
| DL 2108T02 | Power circuit breaker | 4 |
| DL 7901TT | Overhead line model | 1 |
| DL 2108T02/2 | Double busbar with two disconnectors | 3 |
| DL 2109D30 | Digital Power meter | 1 |
| DL 2109D51 | Digital Vector group meter | 1 |
| DL 2102AL | Three-phase supply unit | 1 |
| DL HUBRS485F | Communication MODBUS | 1 |
| DL 2600TTI | Three-phase isolation transformer | 1 |
| DL SCADA-WEB | SCADA Software | 1 |
| DL PCGRID | All-in-One Computer | 1 |
| TLGTU102.X | Cables | 1 |
| DL 1196 | Holder for leads | 1 |
| DL T12090_SK | 120x90 working bench | 1 |
| DL T06090 | 60x90 working bench | 1 |
| DL A120-3M-LED | Three-level work frame with LED light | 1 |